


Schéma chladiaceho-vykurovacieho systému

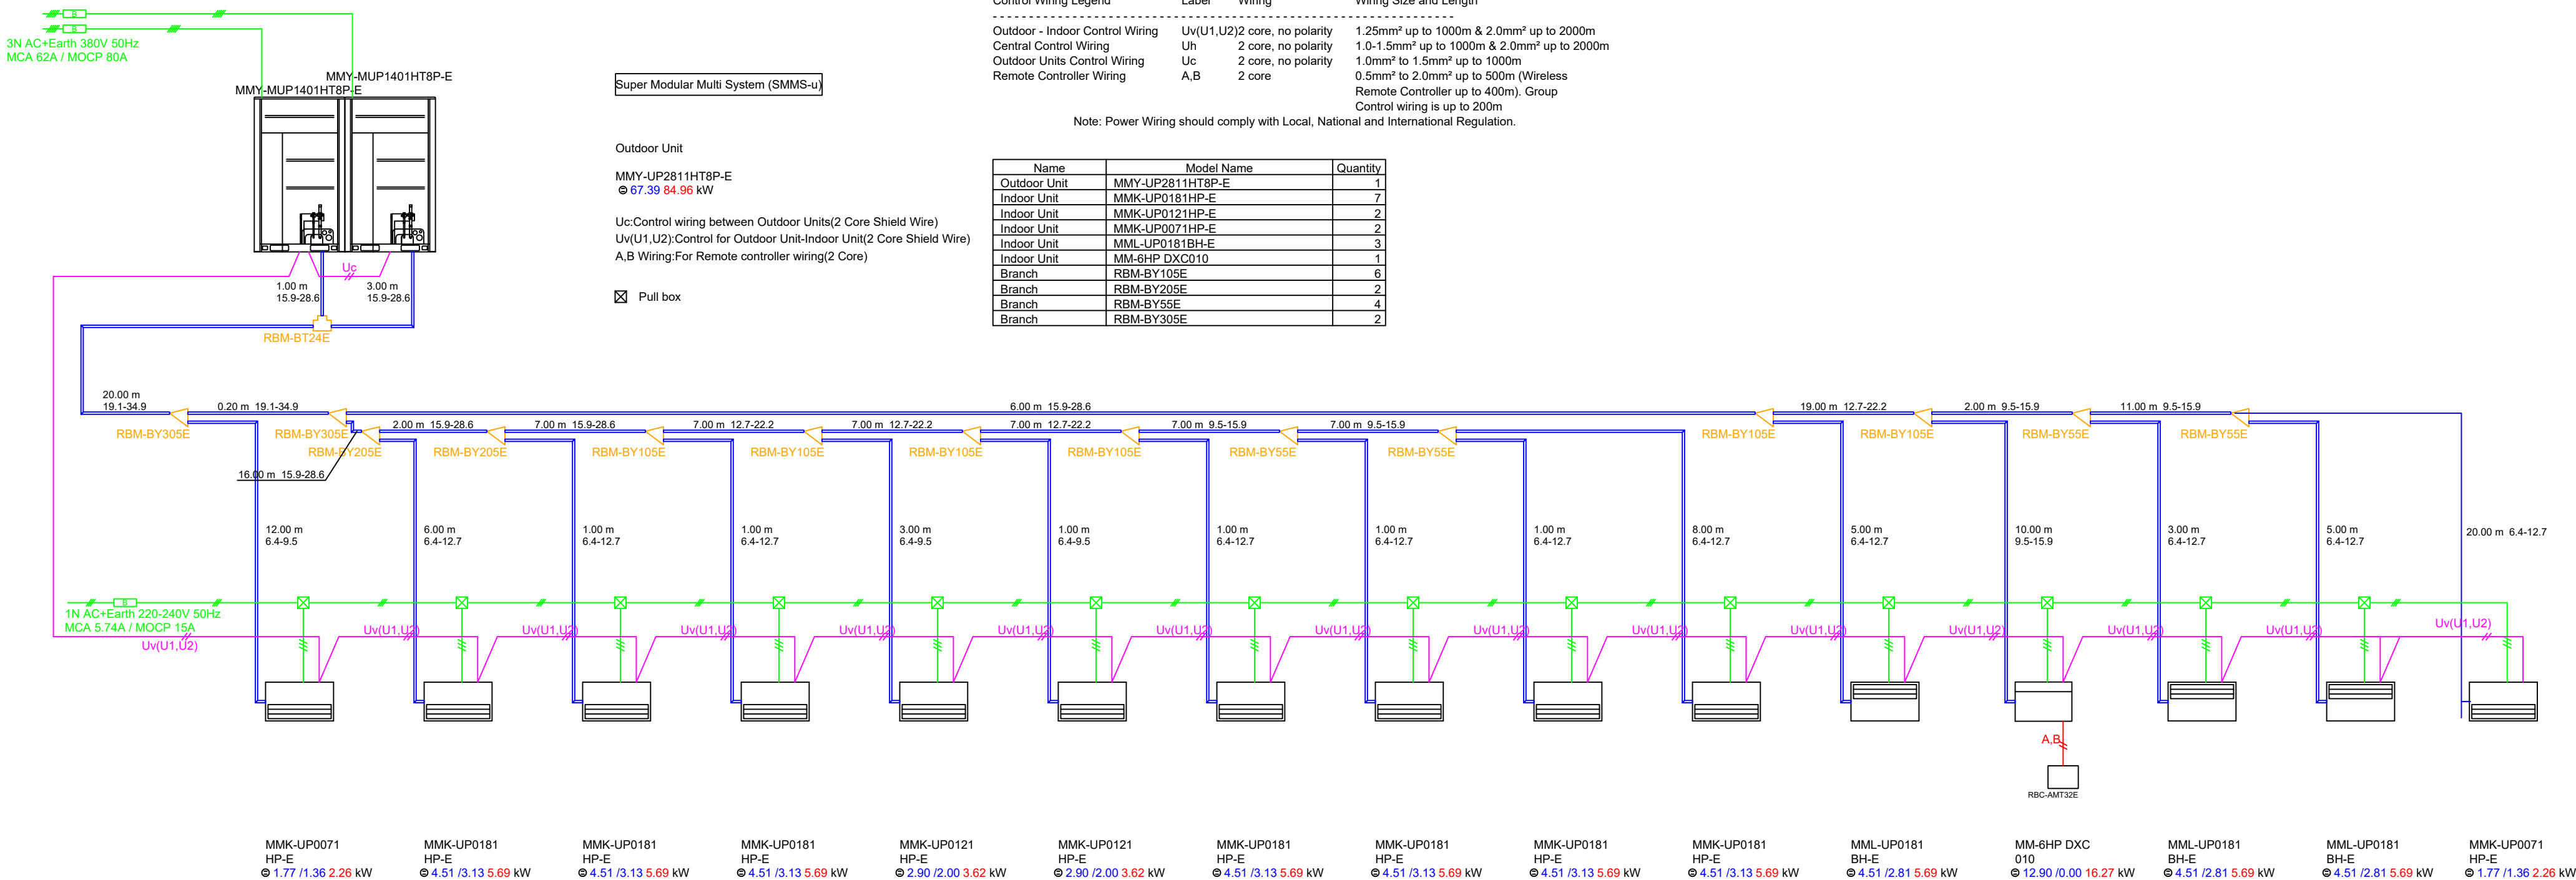

Control Wiring Legend	Label	Wiring	Wiring Size and Length
Outdoor - Indoor Control Wiring	Uv(U1,U2)	2 core, no polarity	1.25mm ² up to 1000m & 2.0mm ² up to 2000m
Central Control Wiring	Uh	2 core, no polarity	1.0-1.5mm ² up to 1000m & 2.0mm ² up to 2000m
Outdoor Units Control Wiring	Uc	2 core, no polarity	1.0mm ² to 1.5mm ² up to 1000m
Remote Controller Wiring	A,B	2 core	0.5mm ² to 2.0mm ² up to 500m (Wireless)

Note: Power Wiring should comply with Local, National and International Regulation.

Name	Model Name	Quantity
Outdoor Unit	MMY-UP2811HT8P-E	1
	MMK-UP0181HP-E	7
Indoor Unit	MMK-UP0121HP-E	2
Indoor Unit	MMK-UP0071HP-E	2
Indoor Unit	MLL-UP0181BH-E	3
Indoor Unit	MM-6HP DXC010	1
Branch	RBM-BY105E	6
Branch	RBM-BY205E	2
Branch	RBM-BY55E	4
Branch	RBM-BY305E	2

	PARÉ:
--	-------

 **FLABRA**

Sídlo: Štúrova 1009/22
929 01 Dunajská Streda

Mobil: 00421 903 508 727
zoltan.hodossy@flabra.sk

Č. účtu: SK90 1100 0000 0029 4601 7603
IČO: 50 133 861 DIČ: 2120 191 194
ID DPH: SK 2120 191 194

VZDUCHOTECHNIKA

DOKUMENTÁCIA PRE STEVEBNÉ POVOLENIE

Názov stavby:

KOMPLEXNÁ REKONŠTRUKCIA
2. NP A REINŠTALÁCIA
EXPOZÍCIE GMM

Obsah výkresu:

Schéma chladiaceho-vykurovacieho systemu

Miesto stavby:
RIMAVSKÁ SOBOTA, č.p.: 639/1,3
KAT.ÚZEMIE - RIMAVSKÁ SOBOTA

Investor:

GEMERSKO-MALOHONTSKÉ MÚZEUM,
NÁM. M. TOMPU 14/5 97901 RIMAVSKÁ
SOBOTA

Hlavný projektant:
ATELIER SZABOK s.r.o.

Zodpovedný:
Ing. Zoltán HODOSSY
Autorizácia - 6482*14

Vypracoval:
Ing. Zoltán HODOSSY

Dátum:	3.2025
--------	--------

Rozmer:	3x A4
---------	-------

Mierka:

Číslo výkresu:	2025357/5
----------------	-----------